


# Wall Sleeve Assembly Instructions

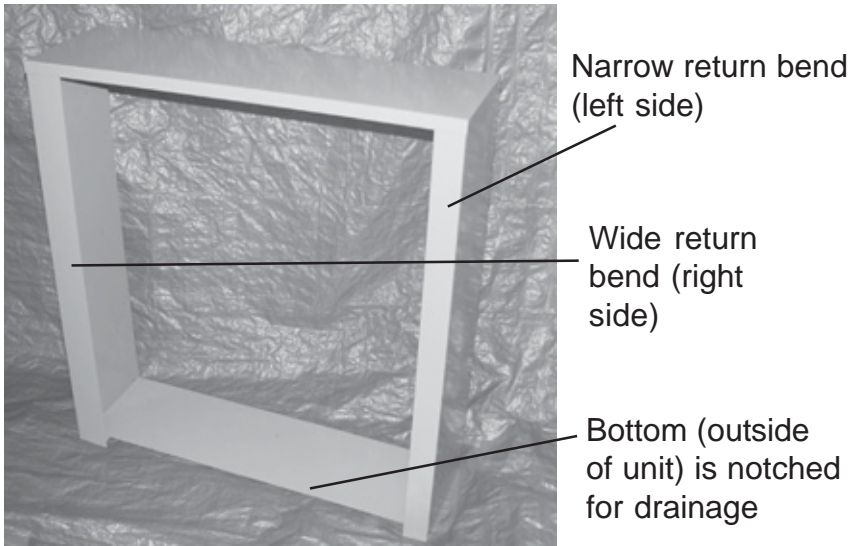


The wall sleeve is shipped as four (4) panels, top, bottom and two sides plus a package of 8 rivets.

The two sides are riveted inside the lid and outside the bottom. The purpose of “lapping” these panels is to minimize water entering between the wall sleeve and THDC/THHP cabinet.

The bottom panel is notched to allow for condensate removal. The right side panel has a wider return bend (3/4”) than the left side panel.



When using architectural grille, remove the standard grille mounted on the unit and use the stainless steel screws to mount the architectural grill on the outside of the wall sleeve. Discard the standard grille.

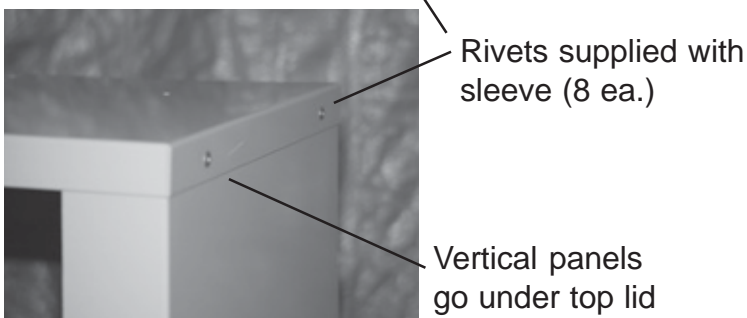

M,R,S, &T Wall Sleeve shown above with architectural grille attached




P Series Grille shown above



929 Eldridge Drive, Hagerstown MD 21740  
Tel: (301)-620-0002 Fax: (301)-620-0685  
www.aerosysinc.com

# Wall Sleeve Dimensional Information

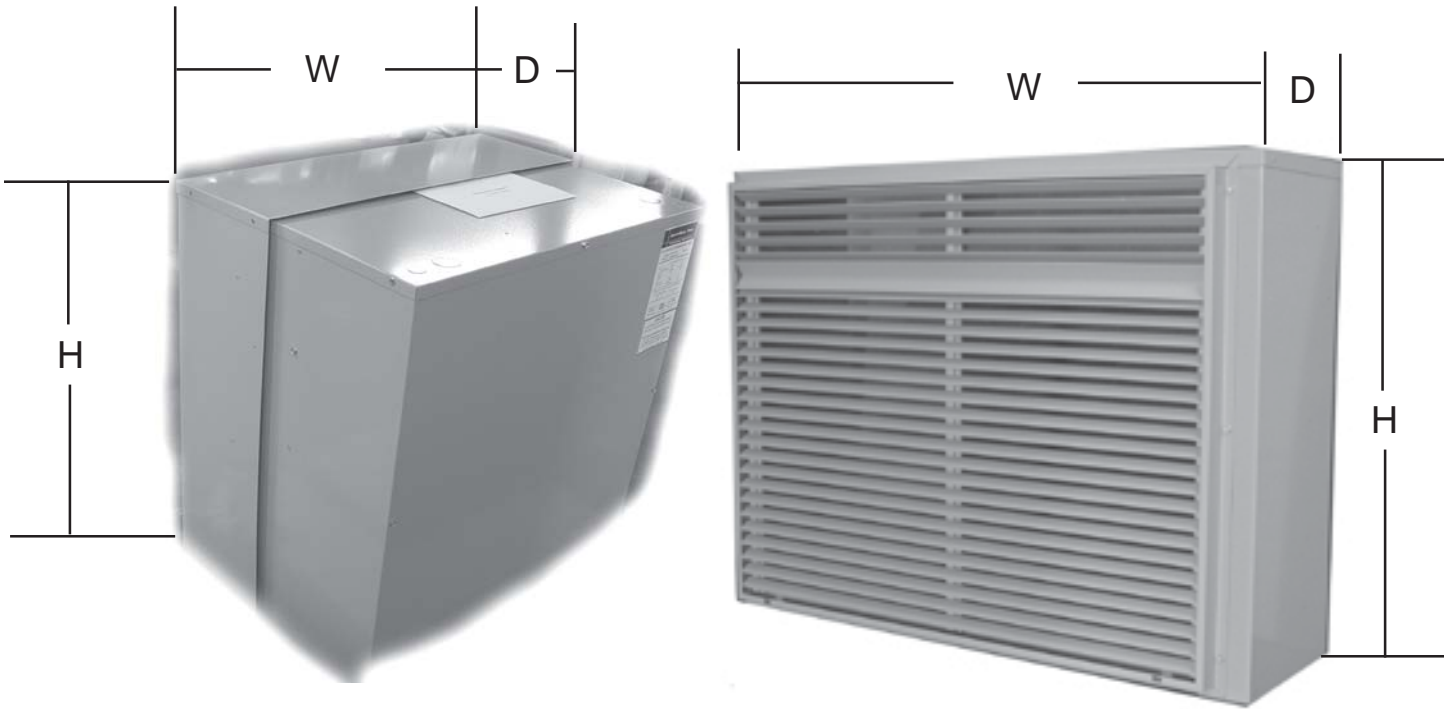

View showing optional Architectural Grille mounted on wall sleeve

THDC/THHP-() Wall Sleeve Dimensions

	H	W	D
“M” (Maxi) Series	23.5	43.0	8.6
“P” (Pygmy) Series	19.5	34.7	8.6
“R” (Runt) Series	23.5	30.5	8.6
“S” (Short) Series	29.0	27.0	8.6
“T” (Tall) Series	32.4	24.8	8.6